

**KAWARTHA PINE RIDGE DISTRICT SCHOOL BOARD  
PUR24-057-ITT  
Warsaw Public School Classroom Upgrades**

---

**ADDENDUM NO. 4**

This addendum shall form an integral part of the bid documents for the above noted Bid and shall be read in conjunction therewith. This addendum shall, however, take precedence over all requirements as it pertains to the particular and specific items noted below.

**ADDITIONAL INFORMATION**

**Add:** Addendum Form, Pinchin File No. 335495.029, Prepared by Pinchin, (2 pages)

**END OF ADDENDUM NO. 4**

**Part 1 General**

**1.1 ADDENDUM FORM**

- .1 This Addendum forms part of the Contract Documents and modifies the Bidding Documents dated March 2024, with amendments and additions noted below.
- .2 This addendum consists of two (2) pages plus the following list of drawings:

No.	Drawing Title	Issue Date
HM-01	Asbestos Specifications	April 8, 2024



**1.2 CHANGES TO THE PROJECT MANUAL**

- .1 DOCUMENT 02 81 00 – HAZARDOUS MATERIALS – GENERAL PROVISIONS
  - .1 Refer to Article 1.3, Paragraph 5 add item:
    - .1 Remove and dispose of asbestos painted concrete block wall to allow for new venting to the exterior in the following locations as marked by the General Contractor:
      - .1 Between Library 16 (Location 26) and exterior, approximately 13 square feet.
- .2 DOCUMENT 02 81 00.01 – ABESTOS ABATEMENT – TYPE 1 PROCEDURES
  - .1 Refer to Article 3, add the following paragraph.
    - .1 Asbestos Removal - - Removal of Other Non-Friable Asbestos Materials, Painted Concrete Block:
      - .1 Wet all material to be disturbed.
      - .2 Use only non-powered hand-held tools to remove concrete blocks in their entirety.
      - .3 Place removed ACM directly into an asbestos waste container.

**1.3 CHANGES TO DRAWINGS**

- .1 DRAWING HM-01 – Asbestos Specifications
  - .1 Computer Lab 16A (Location 47) and Work Area (Location 4) have been removed from the work area.
  - .2 Notation for removal of painted concrete block added to Library 16 (Location 26).

**END OF ADDENDUM NUMBER NO. 335495.029-01**

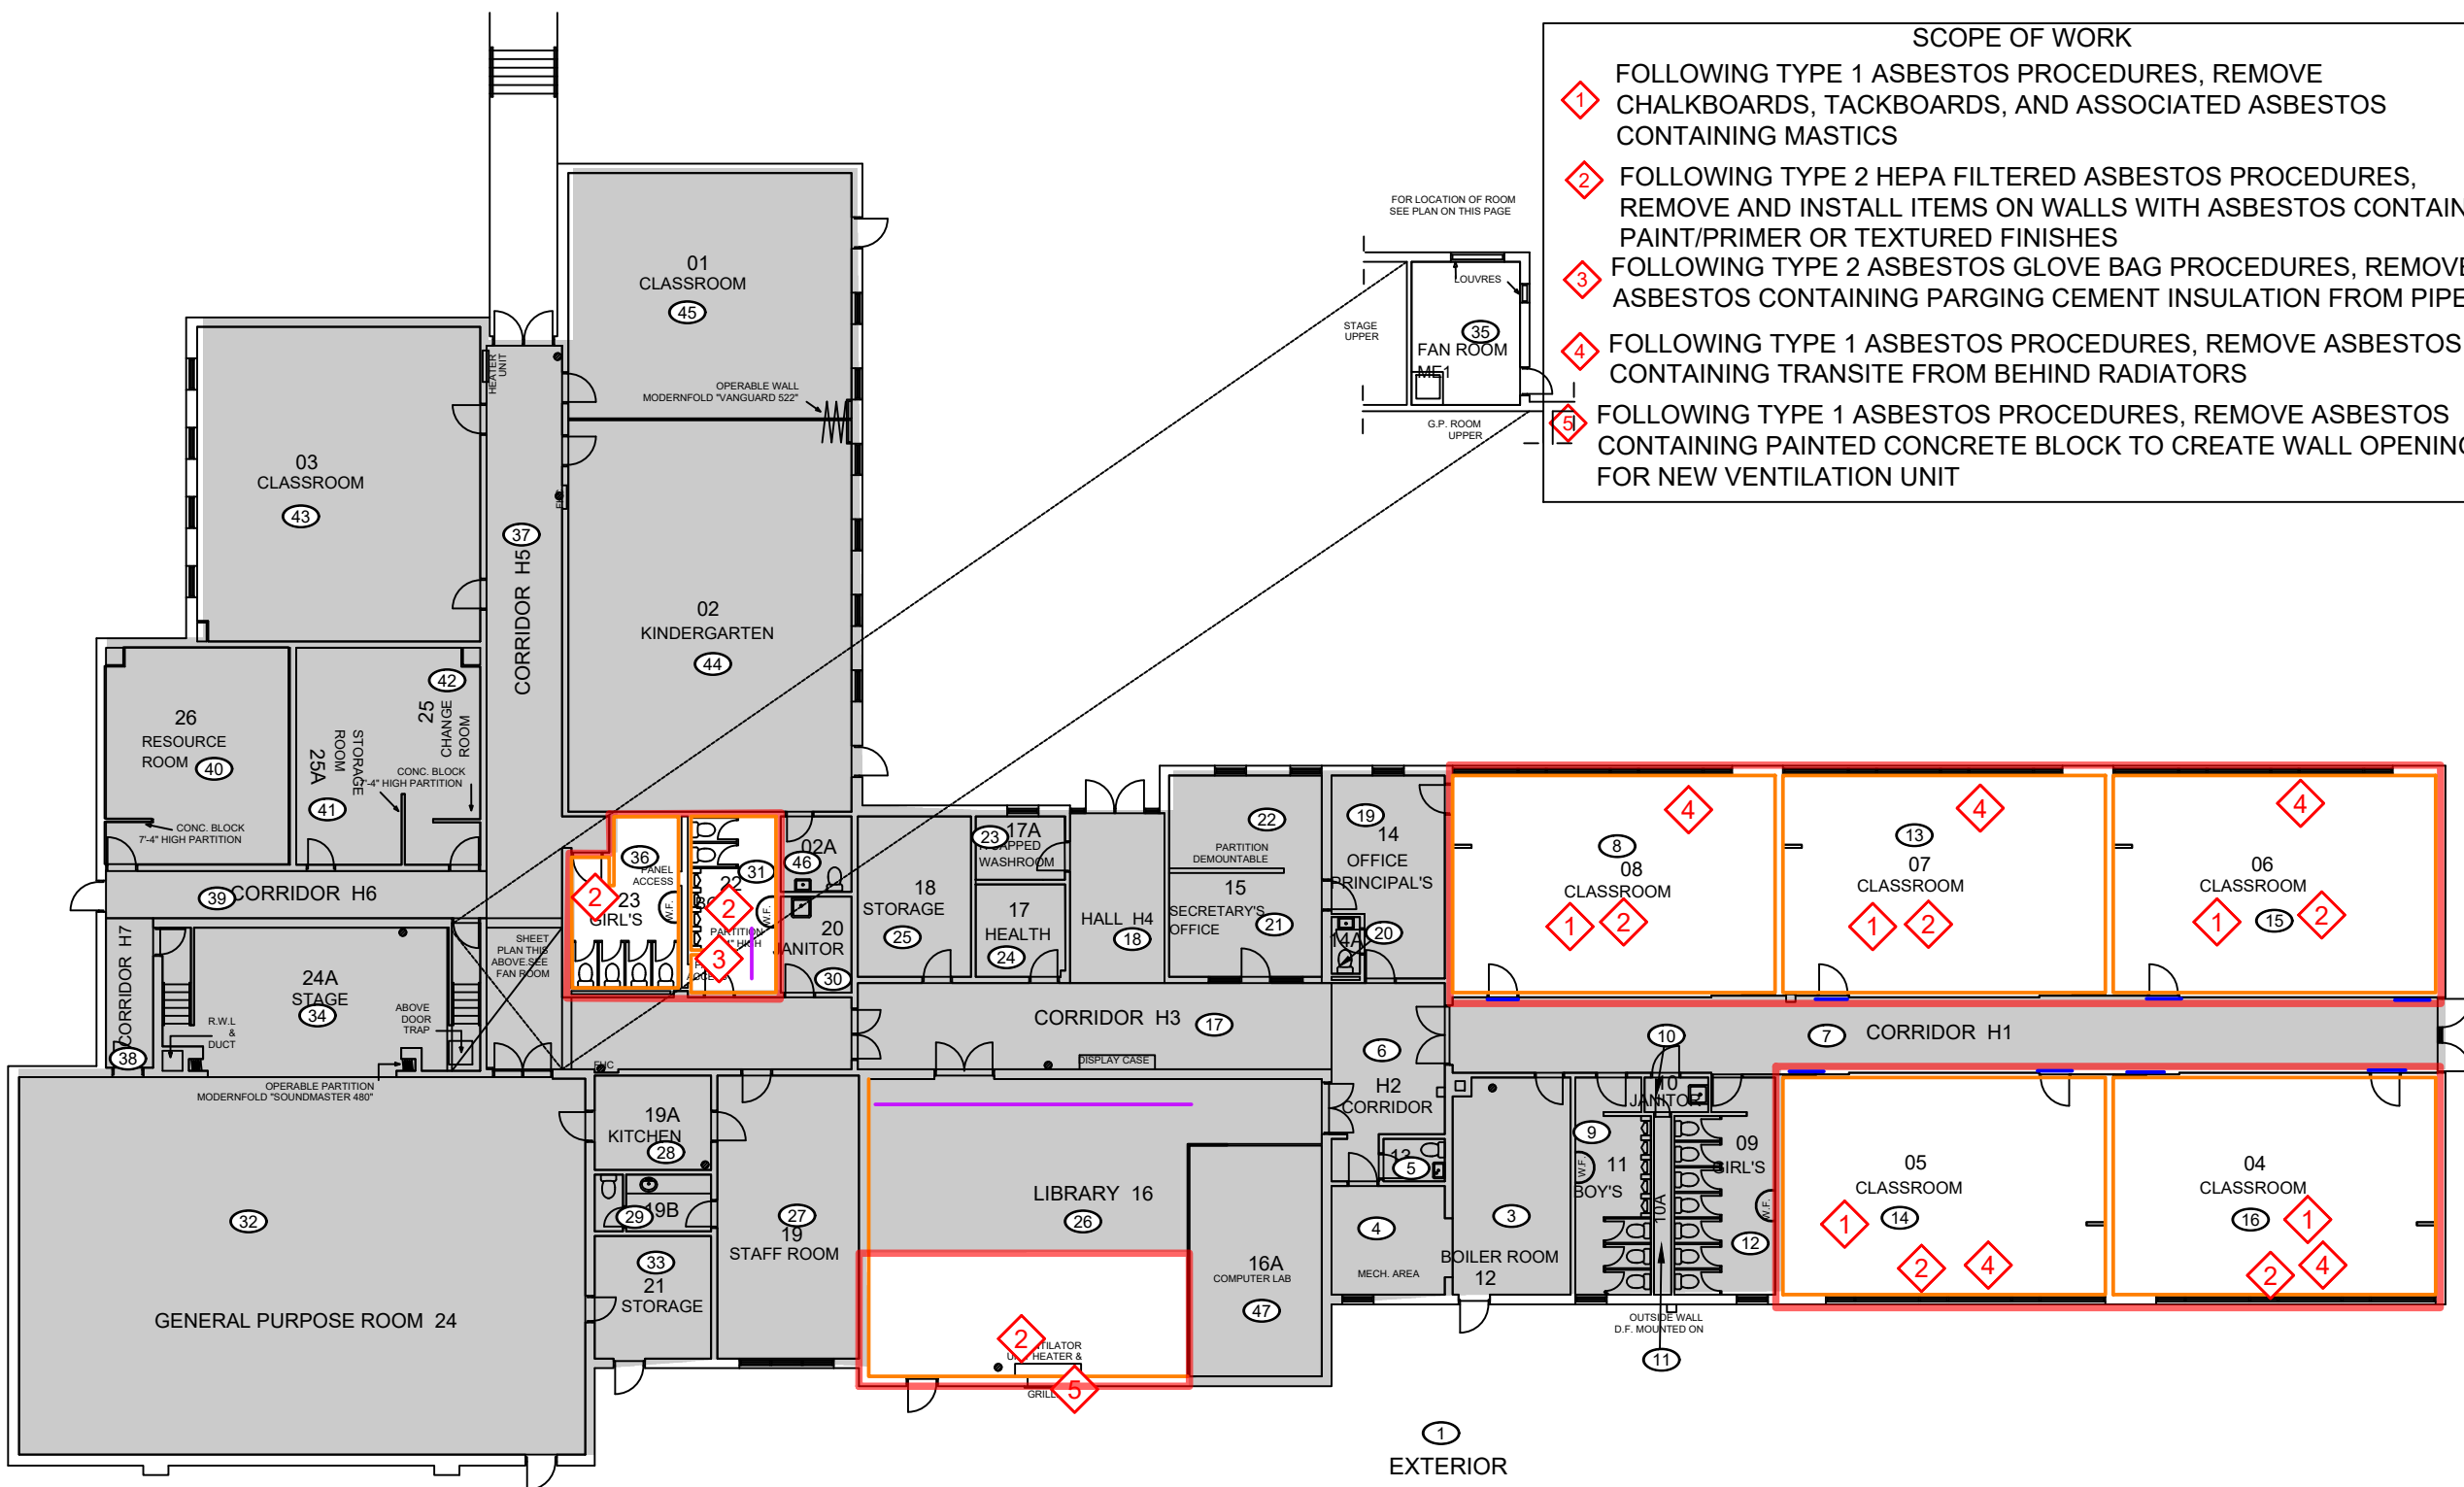

- SCOPE OF WORK**
- 1 FOLLOWING TYPE 1 ASBESTOS PROCEDURES, REMOVE CHALKBOARDS, TACKBOARDS, AND ASSOCIATED ASBESTOS CONTAINING MASTICS
  - 2 FOLLOWING TYPE 2 HEPA FILTERED ASBESTOS PROCEDURES, REMOVE AND INSTALL ITEMS ON WALLS WITH ASBESTOS CONTAINING PAINT/PRIMER OR TEXTURED FINISHES
  - 3 FOLLOWING TYPE 2 ASBESTOS GLOVE BAG PROCEDURES, REMOVE ASBESTOS CONTAINING PARGING CEMENT INSULATION FROM PIPES
  - 4 FOLLOWING TYPE 1 ASBESTOS PROCEDURES, REMOVE ASBESTOS CONTAINING TRANSITE FROM BEHIND RADIATORS
  - 5 FOLLOWING TYPE 1 ASBESTOS PROCEDURES, REMOVE ASBESTOS CONTAINING PAINTED CONCRETE BLOCK TO CREATE WALL OPENING FOR NEW VENTILATION UNIT

- LEGEND**
- WORK AREA
  - OUTSIDE SCOPE
  - PINCHIN LOCATION NUMBER
- ASBESTOS-CONTAINING MATERIALS:
- PAINT AND PRIMER ON BLOCK WALLS
  - PIPE INSULATION
  - WINDOW AND DOOR FRAME CAULKING

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



PROJECT NAME: <b>ASBESTOS SPECIFICATIONS</b>	
CLIENT NAME: <b>KAWARTHA PINE RIDGE DISTRICT SCHOOL BOARD</b>	
PROJECT LOCATION: <b>WARSAW PUBLIC SCHOOL 975 ENGLISH LINE SOUTH WARSAW, ONTARIO</b>	
FIGURE NAME: <b>WORK AREAS GROUND FLOOR</b>	
PROJECT NUMBER: <b>335495.029</b>	SCALE: <b>NOT TO SCALE</b>
DRAWN BY: <b>RN</b>	REVIEWED BY: <b>DC</b>
DATE: <b>APRIL 8, 2024</b>	FIGURE NUMBER: <b>HM-01</b>